
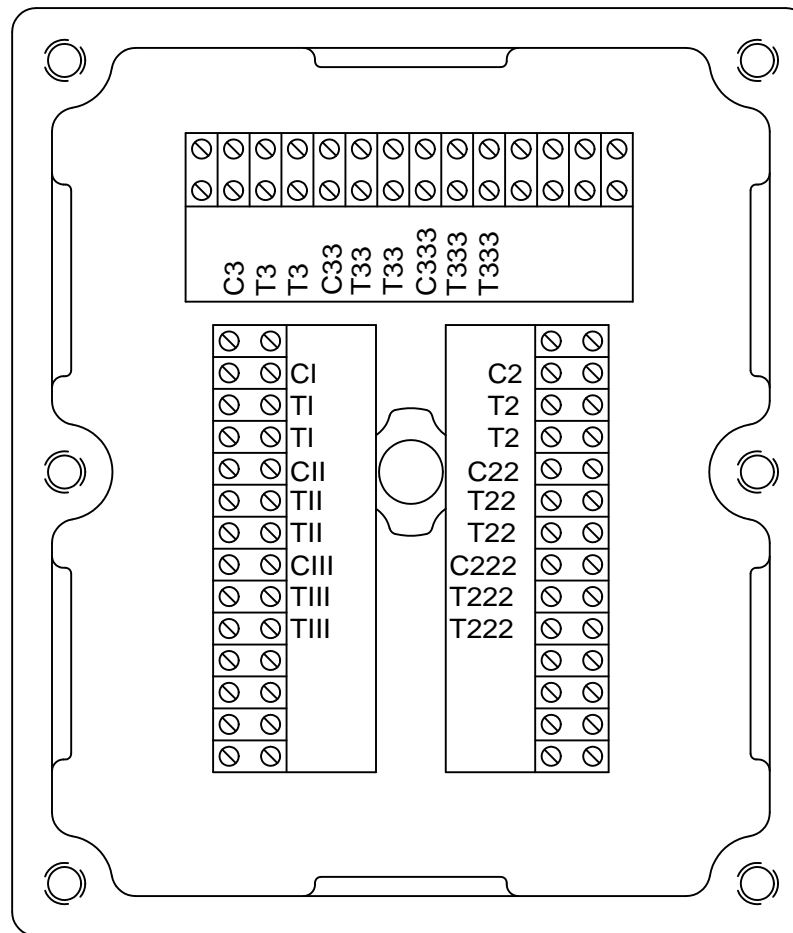


WINDING RTD'S

1. THERE ARE QTY-9 RESISTANCE TYPE TEMPERATURE DETECTORS (RTD) INSTALLED IN THE STATOR WINDING, 3 PER PHASE. REFER TO NAMEPLATE ATTACHED TO THE MOTOR ADJACENT TO ACCESSORY OUTLET BOX FOR RATING OF THE RTD'S.
2. DETECTORS ARE INSTALLED IN PHASES AS SHOWN.

PHASE	A	B	C
RTD NO.	1, 11, 111	2, 22, 222	3, 33, 333

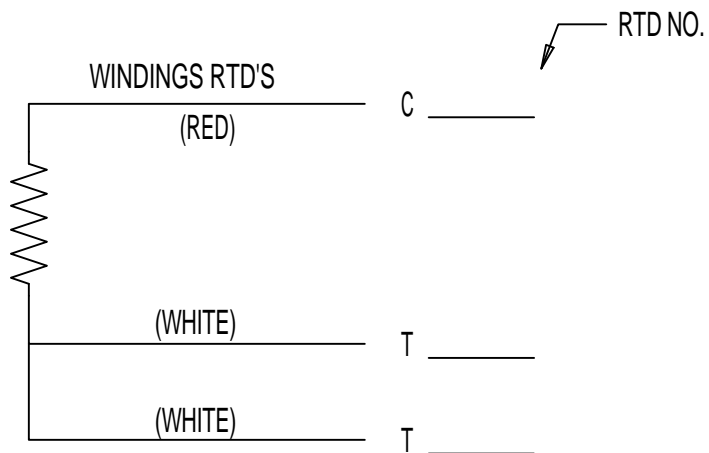

ACCESSORY LISTING
QTY-9 3 LEAD RTD'S

REVISION DESCRIPTION FOR: 20160226	SCALE NONE	UNITS IN	TITLE CUSTOMER CONNECTION DIAGRAM		NIDEC MOTOR CORPORATION
ADDED OUTLET BOX DETAIL.	TOLERANCES ON DIMENSIONS (UNLESS OTHERWISE SPECIFIED)		ISSUED BY R. KING		
MATERIAL: ---	INCHES	mm	CODE		REVISION DATE 10-MAY-16
MUST BE COMPLIANT TO RoHS DIRECTIVE EU 2002/95/IEC AND REGULATION EC 1907/2006 (REACH) AS AMENDED	ANGLES X°= ±1°		DWG NO. 0426979		REV C
					SHEET NUMBER 1 OF 1
					DWG SIZE A