




484171

SUMP HEATER CONNECTION DIAGRAM

SUMP HEATER LEADS MAY BE LOCATED IN EITHER THE SUMP HEATER TERMINAL BOX OR IF SO EQUIPPED, A WINDING LEADS AUXILIARY BOX

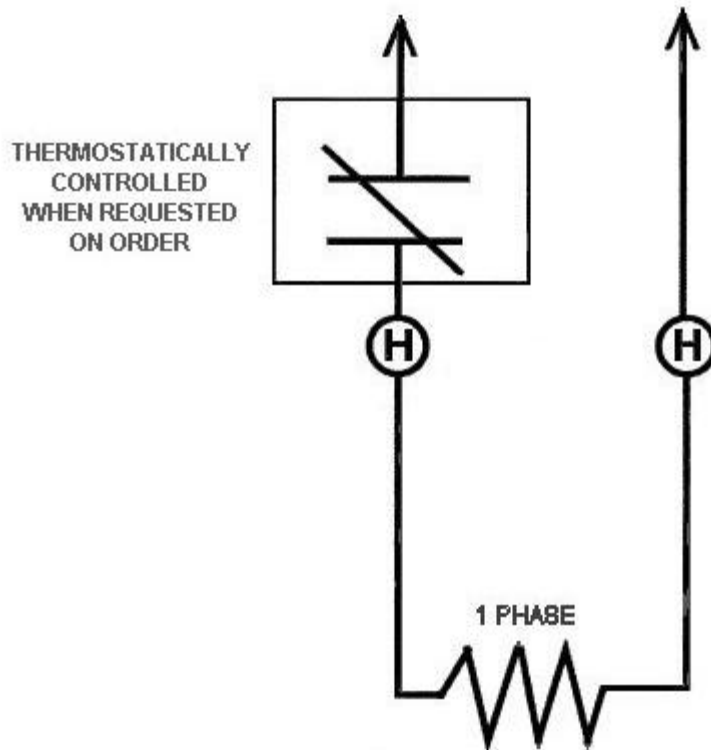

THIS EQUIPMENT IS SUPPLIED WITH OIL SUMP HEATERS. HEATERS SHOULD BE ENERGIZED WHEN EQUIPMENT IS NOT OPERATING TO PROTECT UNIT BY PREVENTING INTERNAL CONDENSATION. CONNECT THE "H" OR HEATER LEADS TO

VOLTS	WATTS RATING
-------	--------------

SUMP HEATER NAMEPLATE (ON MOTOR)